


Signature Sliding Window (100mm)

Installation Details

BRICK VENEER CONSTRUCTION - SILL & JAMB DETAIL

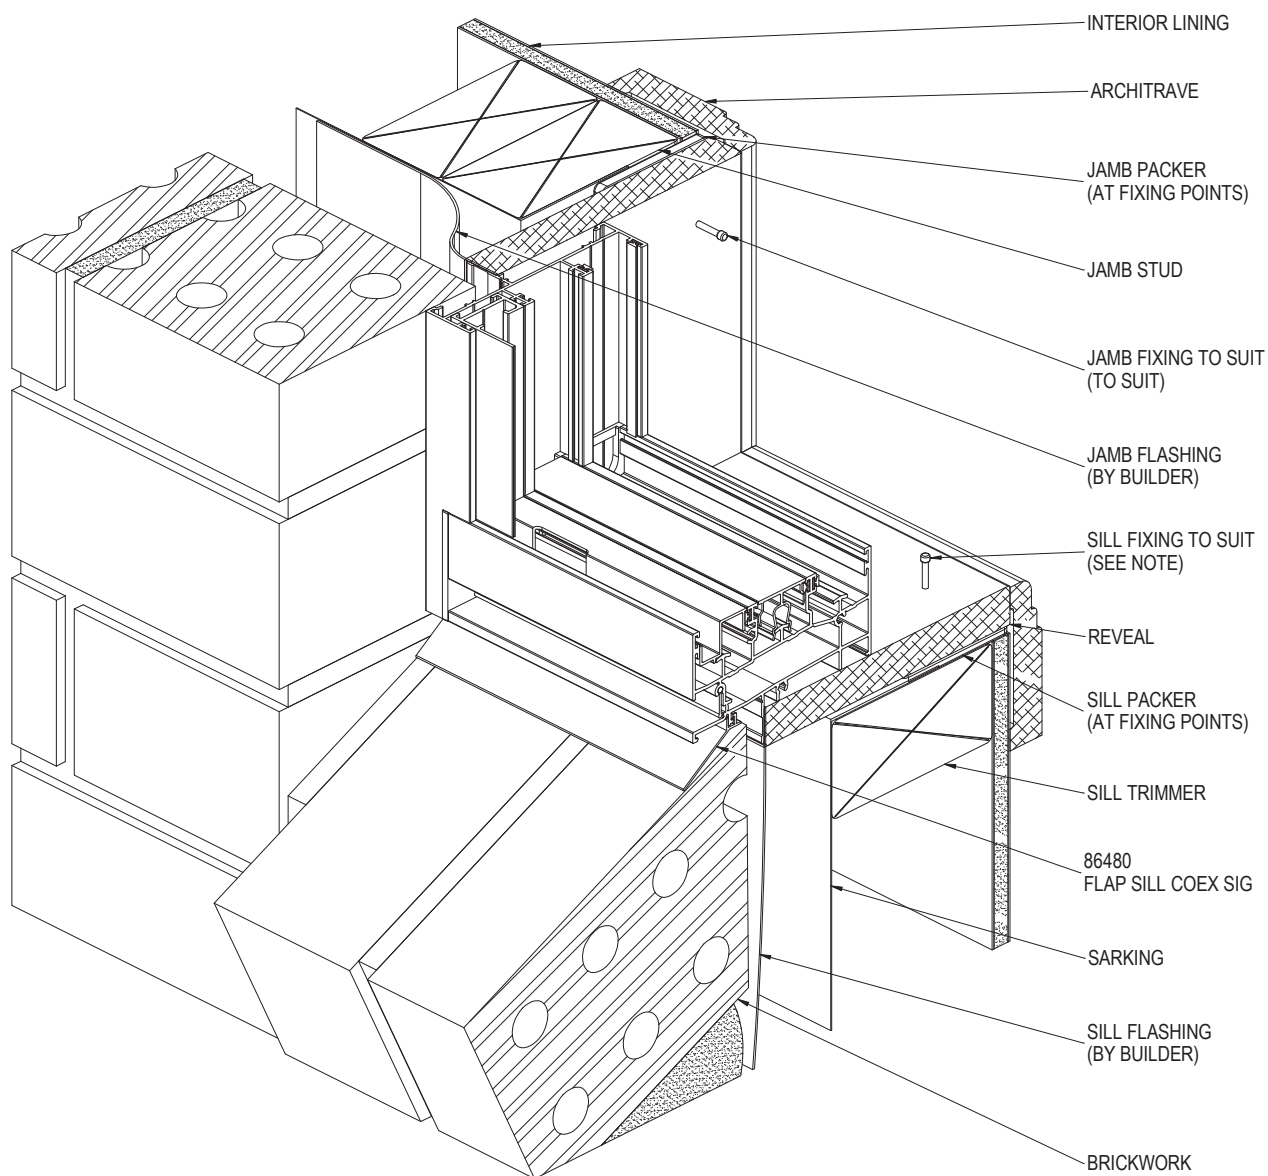


NOTE:
FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A $\phi 2.2\text{mm}$ STEEL NAIL MINIMUM.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-01
DRAWN: DJH

DATE: 22/12/15
ISSUE: B
SCALE: 1 : 3

BRICK VENEER CONSTRUCTION - HEAD & JAMB DETAIL

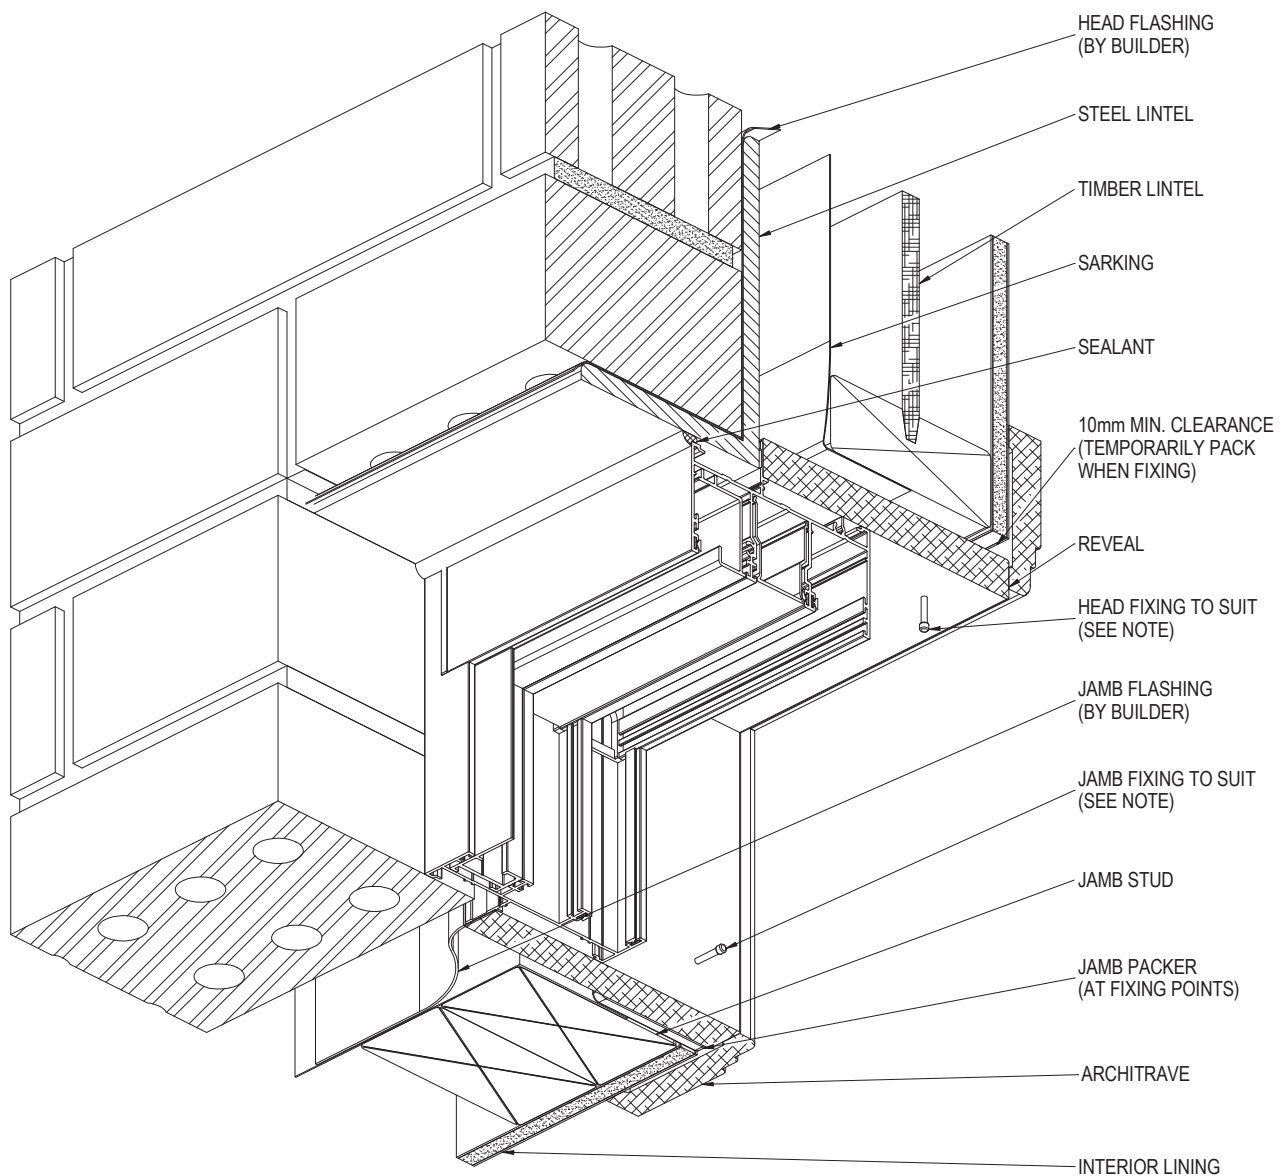

NOTE:
FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A ϕ 2.2mm STEEL NAIL MINIMUM.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-02
DRAWN: DJH


DATE: 03/09/09

ISSUE: A

SCALE: 1 : 3



CLADDING CONSTRUCTION - SILL & JAMB DETAIL

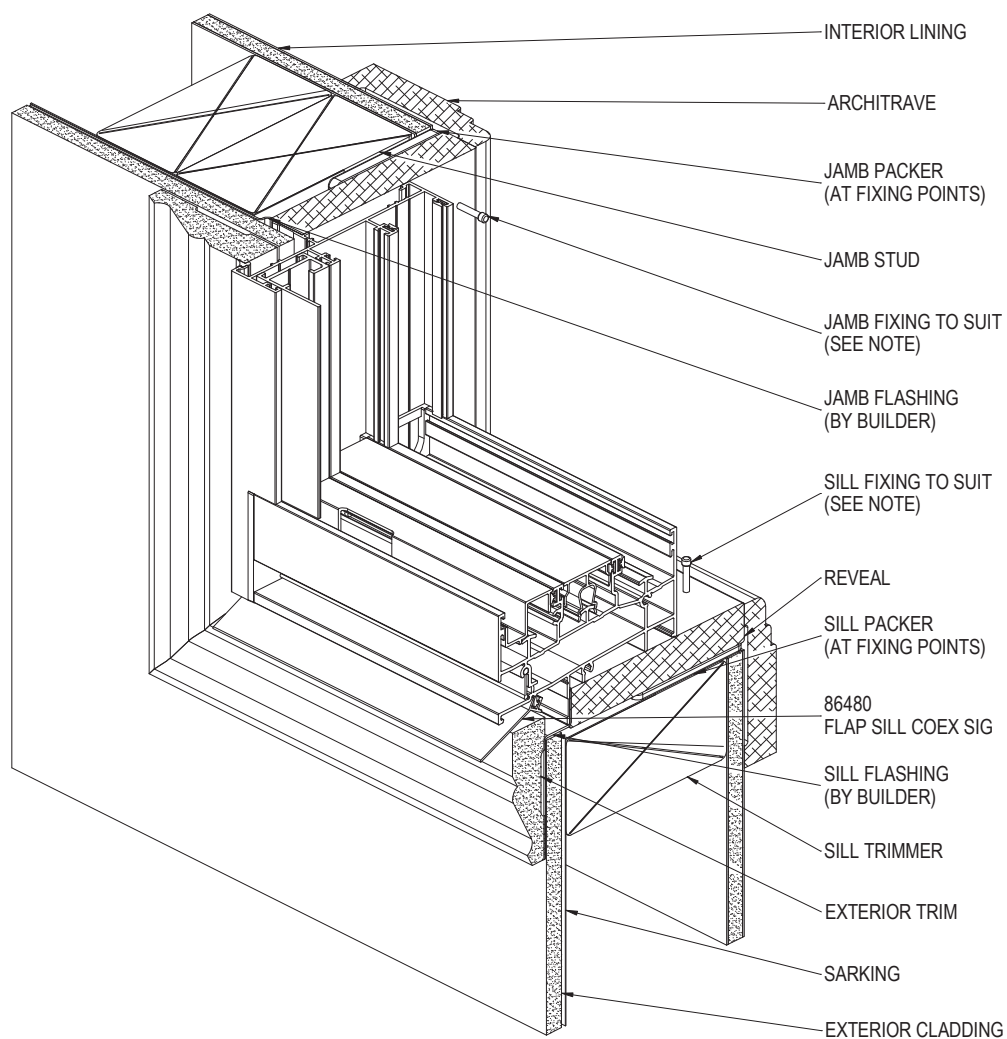

NOTE:
FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A ϕ 2.2mm STEEL NAIL MINIMUM.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-03
DRAWN: DJH


DATE: 22/12/15

ISSUE: B

SCALE: 1 : 3



CLADDING CONSTRUCTION - HEAD & JAMB DETAIL

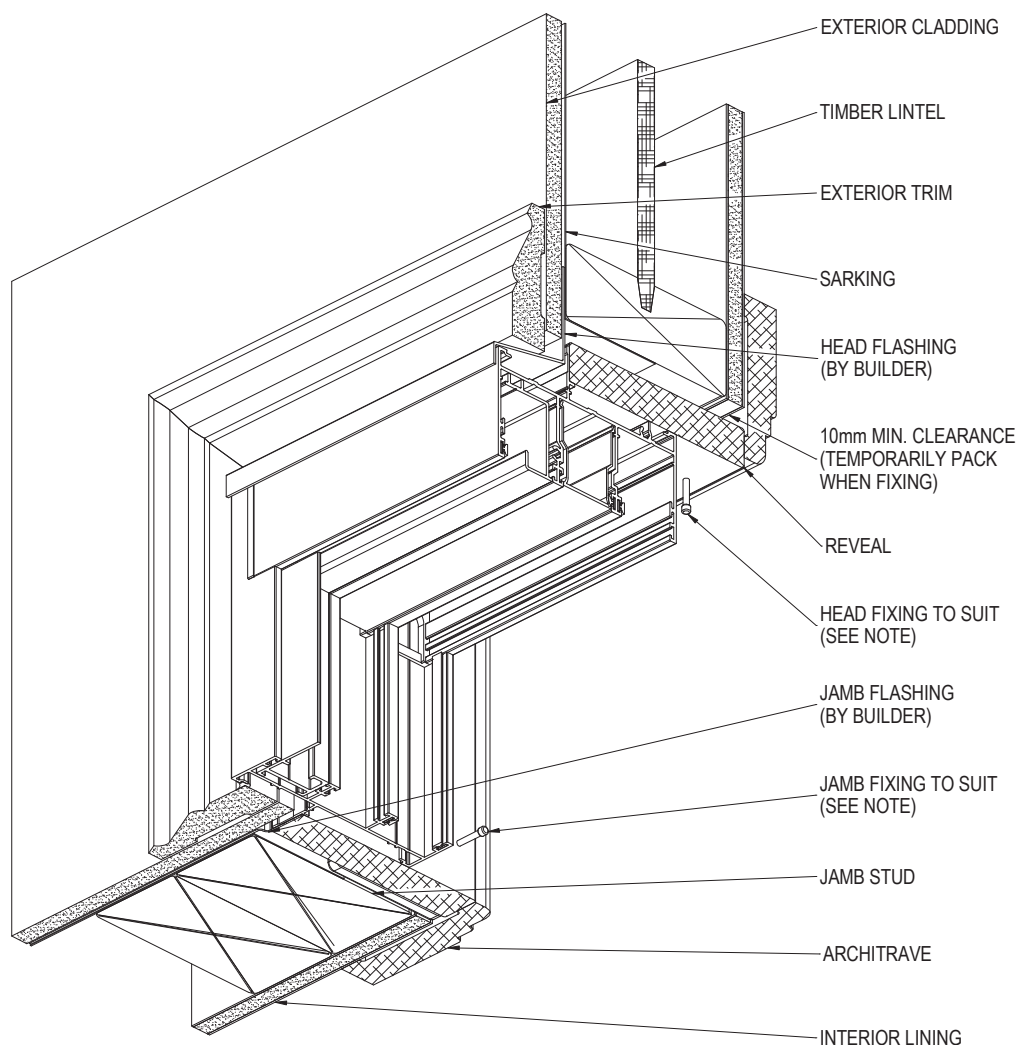


NOTE:
FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A ϕ 2.2mm STEEL NAIL MINIMUM.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-04
DRAWN: DJH

DATE: 03/09/09
ISSUE: A
SCALE: 1 : 3



CAVITY BRICK CONSTRUCTION - SILL & JAMB DETAIL

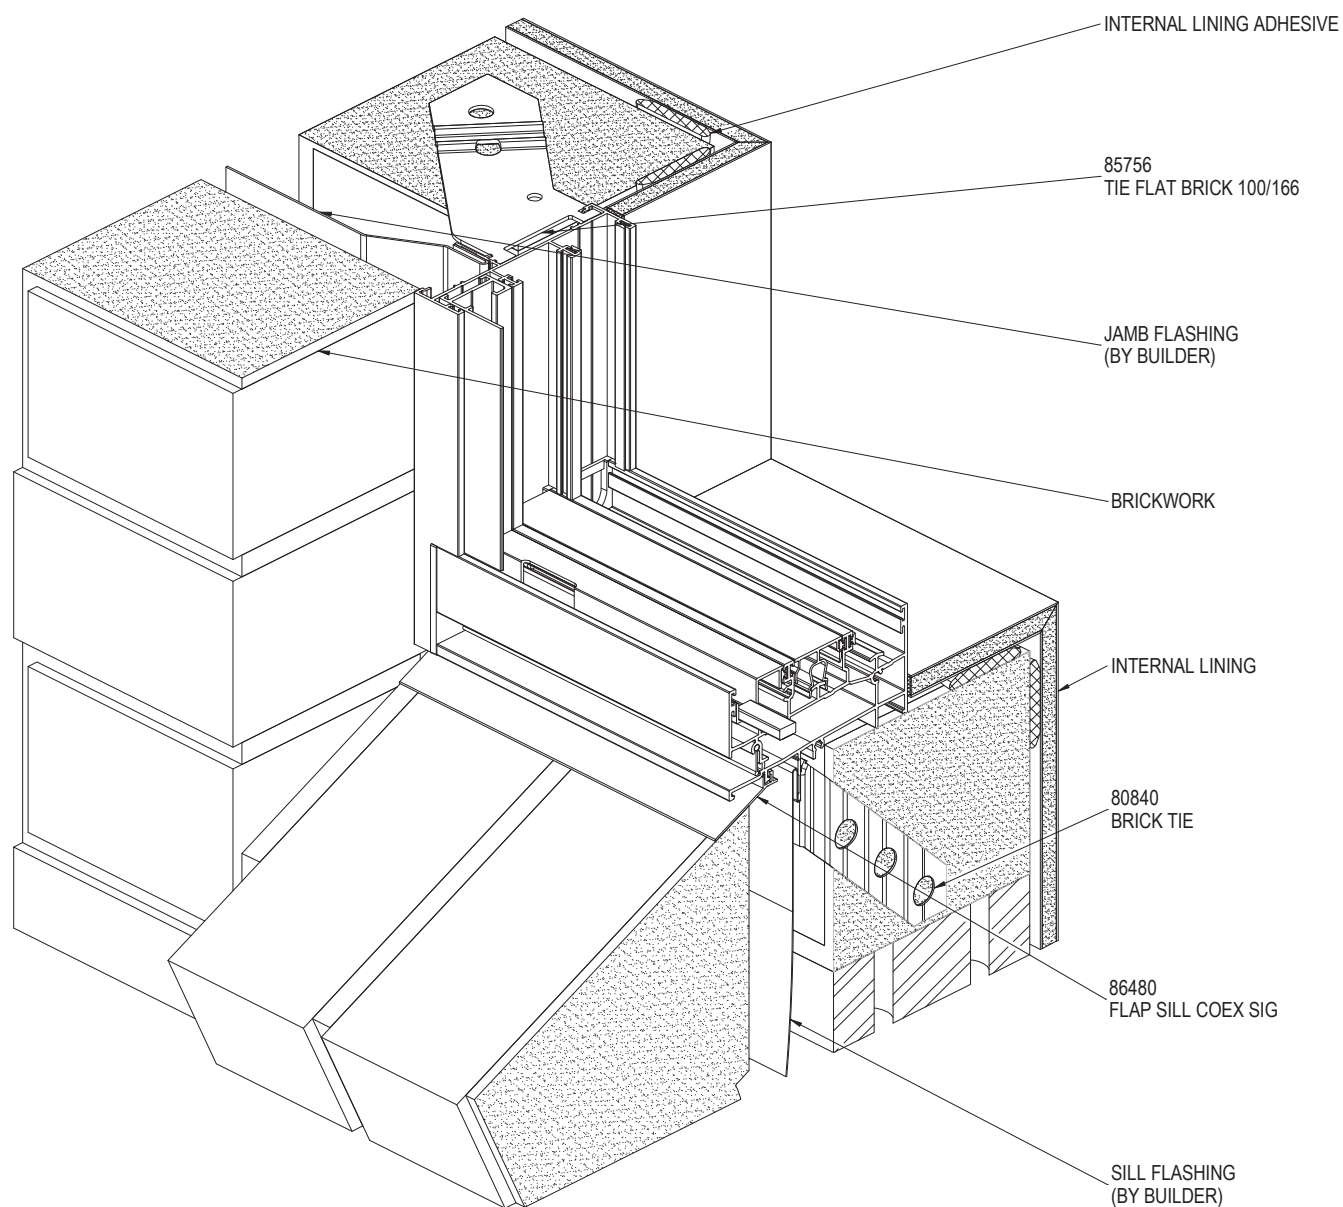

NOTE:
FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A $\phi 2.2$ mm STEEL NAIL MINIMUM.


PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-05
DRAWN: DJH

DATE: 23/12/15

ISSUE: B

SCALE: 1 : 3

CAVITY BRICK CONSTRUCTION - HEAD & JAMB DETAIL

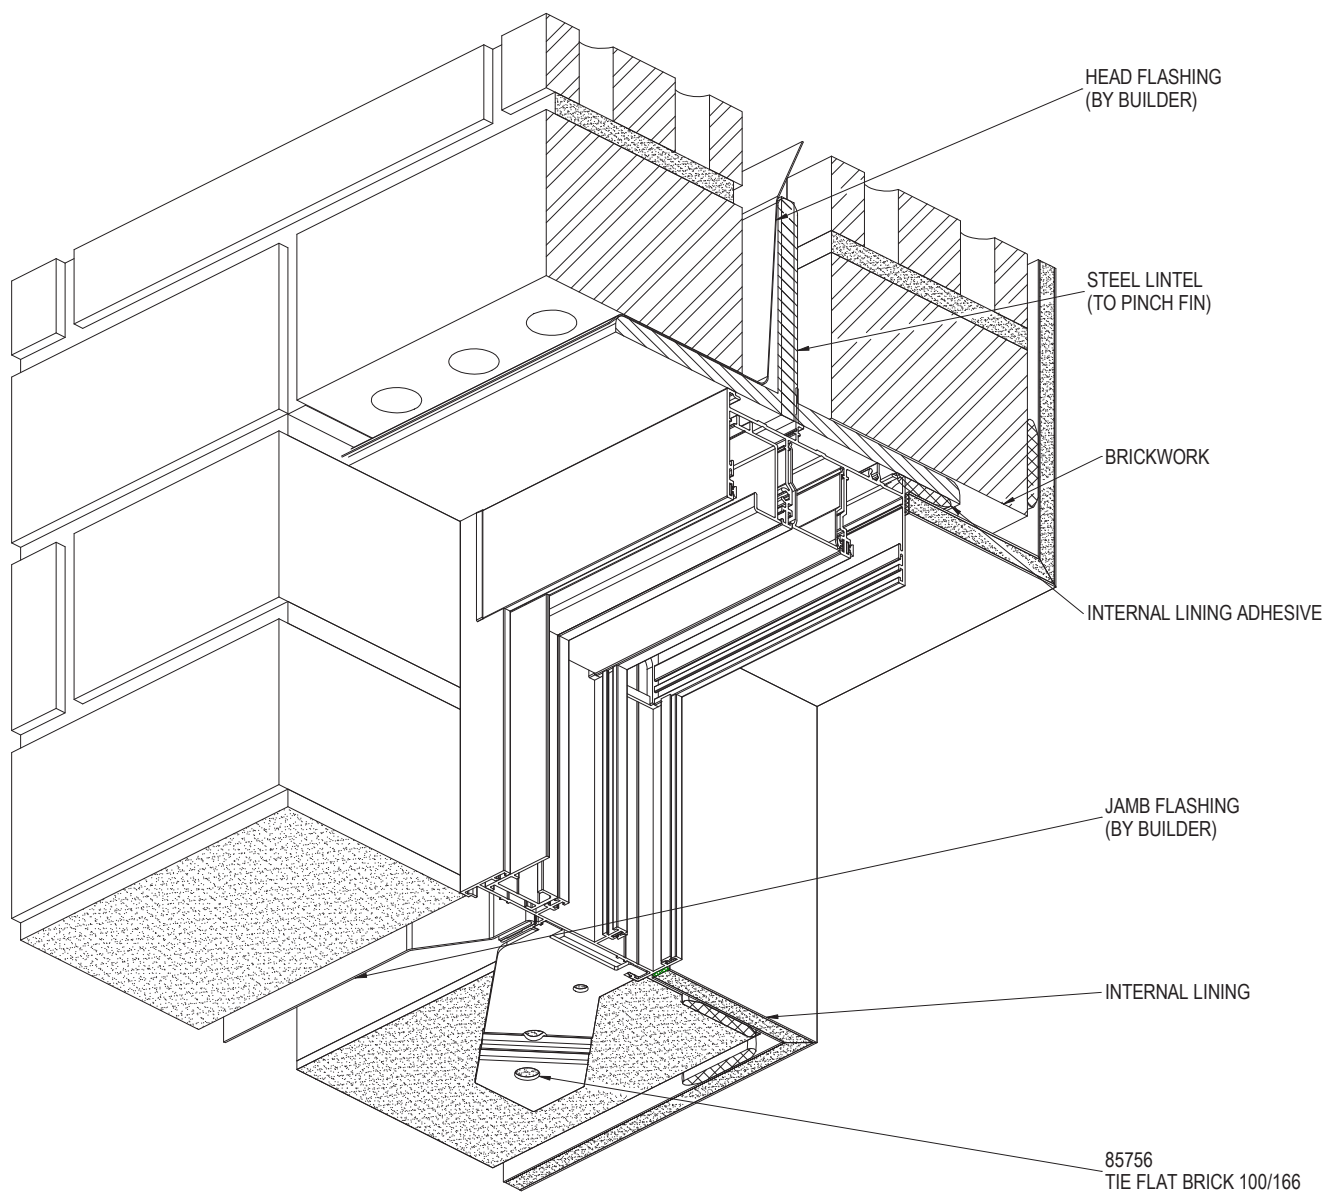

NOTE:
FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A $\phi 2.2$ mm STEEL NAIL MINIMUM.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-06
DRAWN: DJH

DATE: 23/12/15

ISSUE: B

SCALE: 1 : 3



Bradnam's
windows & doors

INTERNAL LINING

INTERNAL LINING ADHESIVE

REINFORCING BAR

PACKER (AT FIXING POINTS)

ANCHOR FIXING (SEE NOTE)

SEAL FRAME TO OPENING

FIX ANGLE TO FRAME WITH S.S. RIVET

BX336 (2304)
ANGLE 40 x 25 x 2.7mm
(SEAL TO OPENING & FRAME)

FIXING TO SUIT
(SEAL OVER FIXING HEAD)

86480
FLAP SILL COEX SIG


BLOCKWORK (SEE NOTE)

FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A ϕ 2.2mm STEEL NAIL MINIMUM.

SCALE: 1 : 3



BLOCKWORK CONSTRUCTION - HEAD & JAMB DETAIL

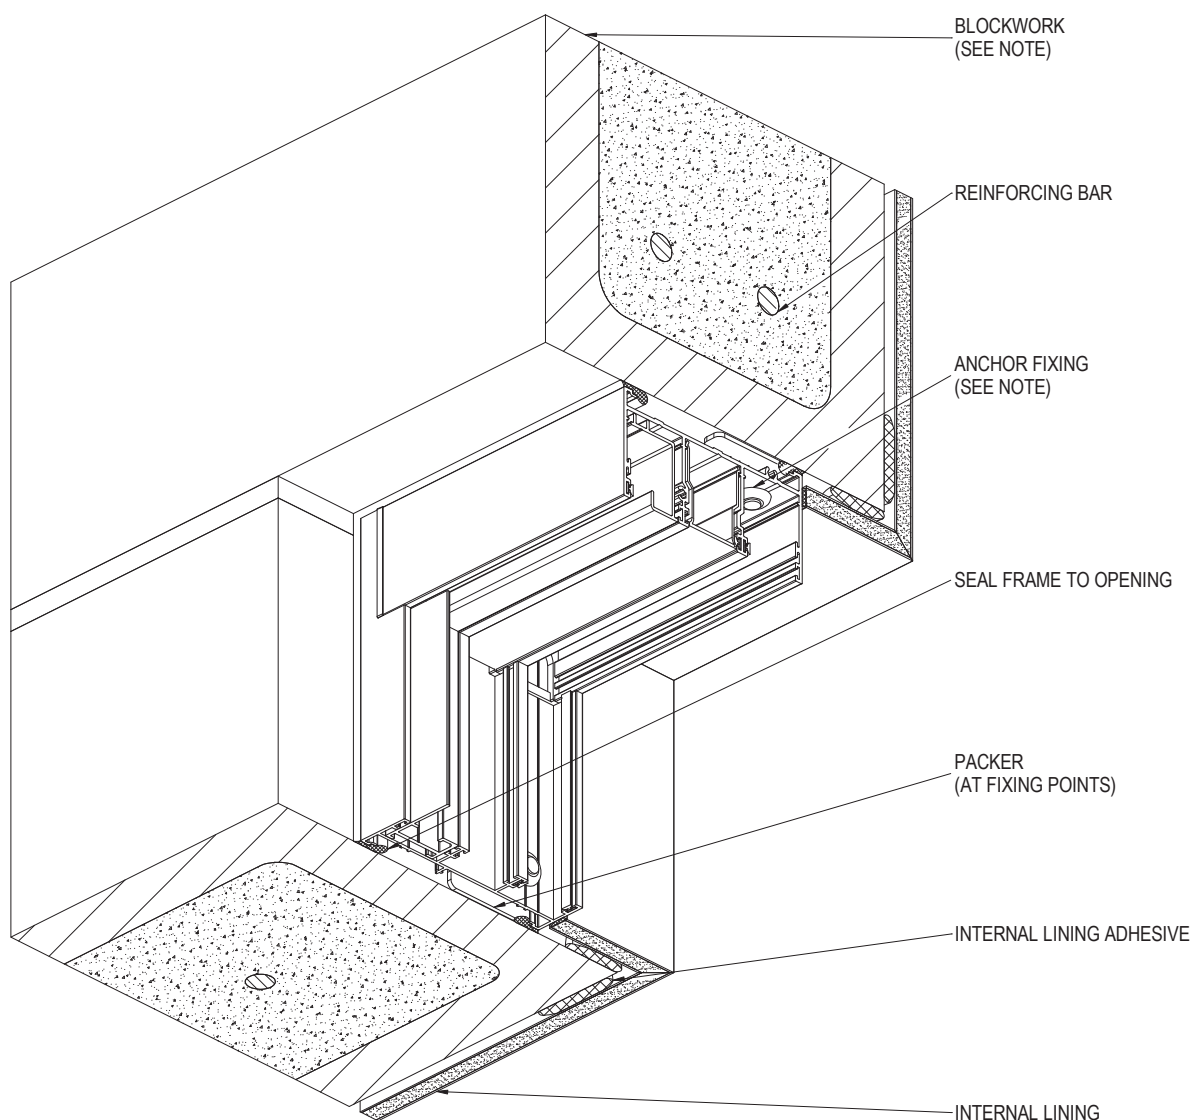

NOTE:
SURFACE OF BLOCKS TO WINDOW OPENING MUST BE TANKED WITH A SUITABLE SEALER TO PREVENT INGRESS OF MOISTURE. ENSURE SURFACES TO BE SEALED ARE SOUND, CLEAN, DRY AND FREE FROM ANY CONTAMINANTS BEFORE SEALING.

FOR SITE CLASSIFICATIONS OF UP TO AND INCLUDING 'N6' OR SIMILAR, FIXINGS ARE TO BE AT 450mm CENTRE MAXIMUM, FOR SITUATIONS IN EXCESS OF THIS THE FIXINGS ARE TO BE AT 300mm CENTRES MAXIMUM. FIXING SIZE TO BE EQUIVALENT TO A $\phi 2.2$ mm STEEL NAIL MINIMUM.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-08
DRAWN: DJH

DATE: 03/09/09


ISSUE: A

SCALE: 1 : 3



Bradnam's
windows & doors

TILT SLAB CONSTRUCTION - SILL & JAMB DETAIL

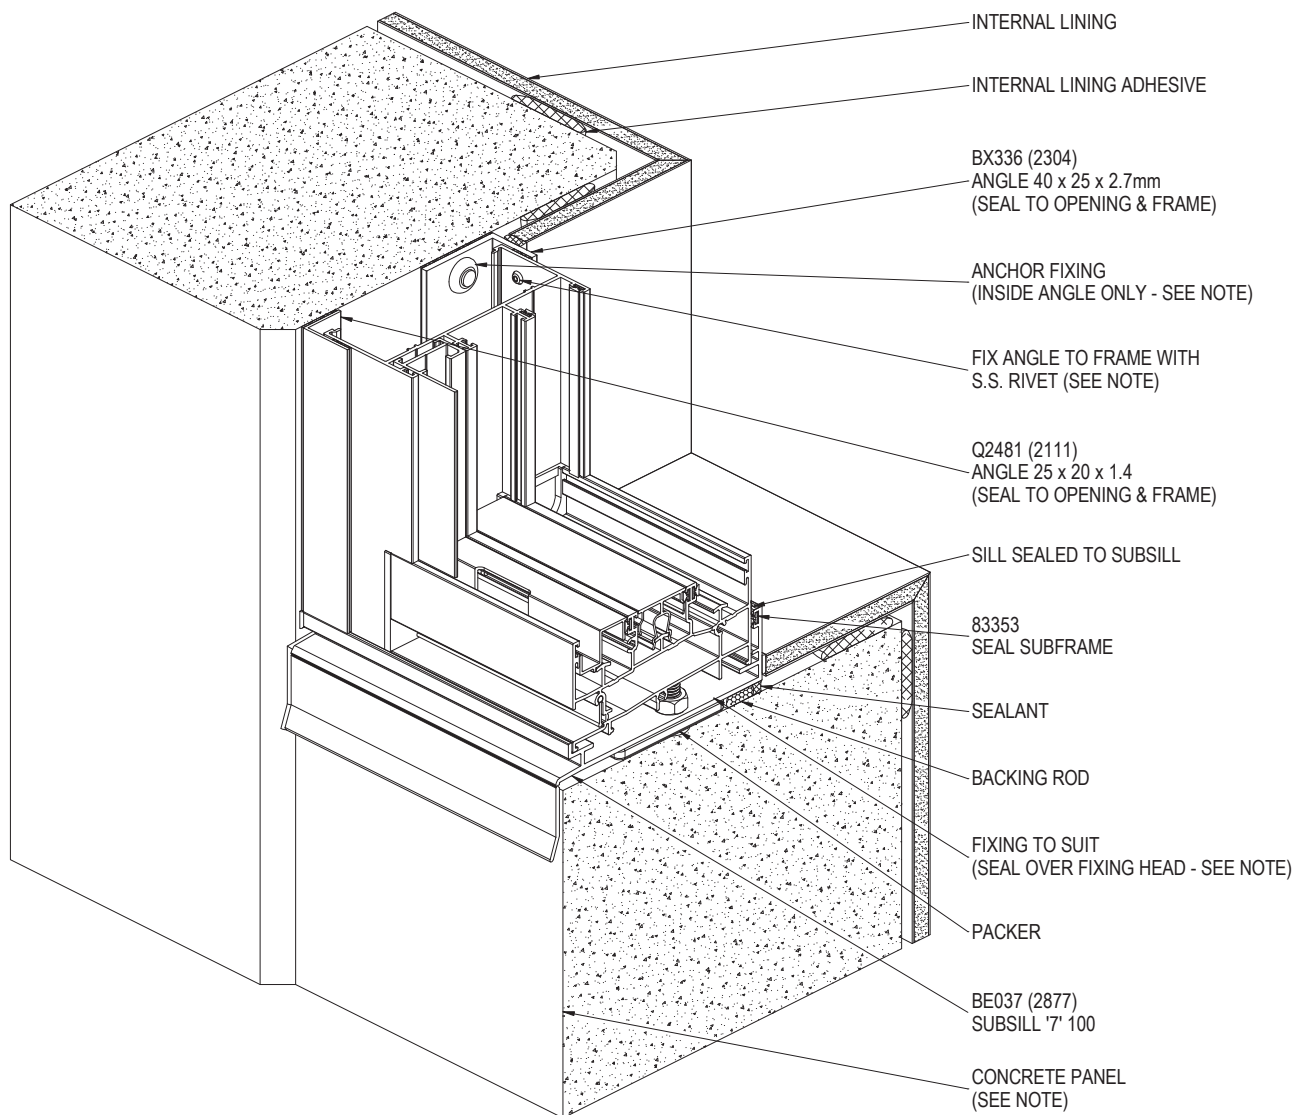

NOTE:
SURFACE OF CONCRETE TO WINDOW OPENING MUST BE TANKED WITH A SUITABLE SEALER TO PREVENT INGRESS OF MOISTURE. ENSURE SURFACES TO BE SEALED ARE SOUND, CLEAN, DRY AND FREE FROM ANY CONTAMINANTS BEFORE SEALING.


FIXING TYPES & CENTRES TO BE PROJECT SPECIFIC, REFER TO SPECIFICATION AND/OR ENGINEER.

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-09
DRAWN: DJH

DATE: 03/09/09
ISSUE: A
SCALE: 1 : 3



TILT SLAB CONSTRUCTION - HEAD & JAMB DETAIL

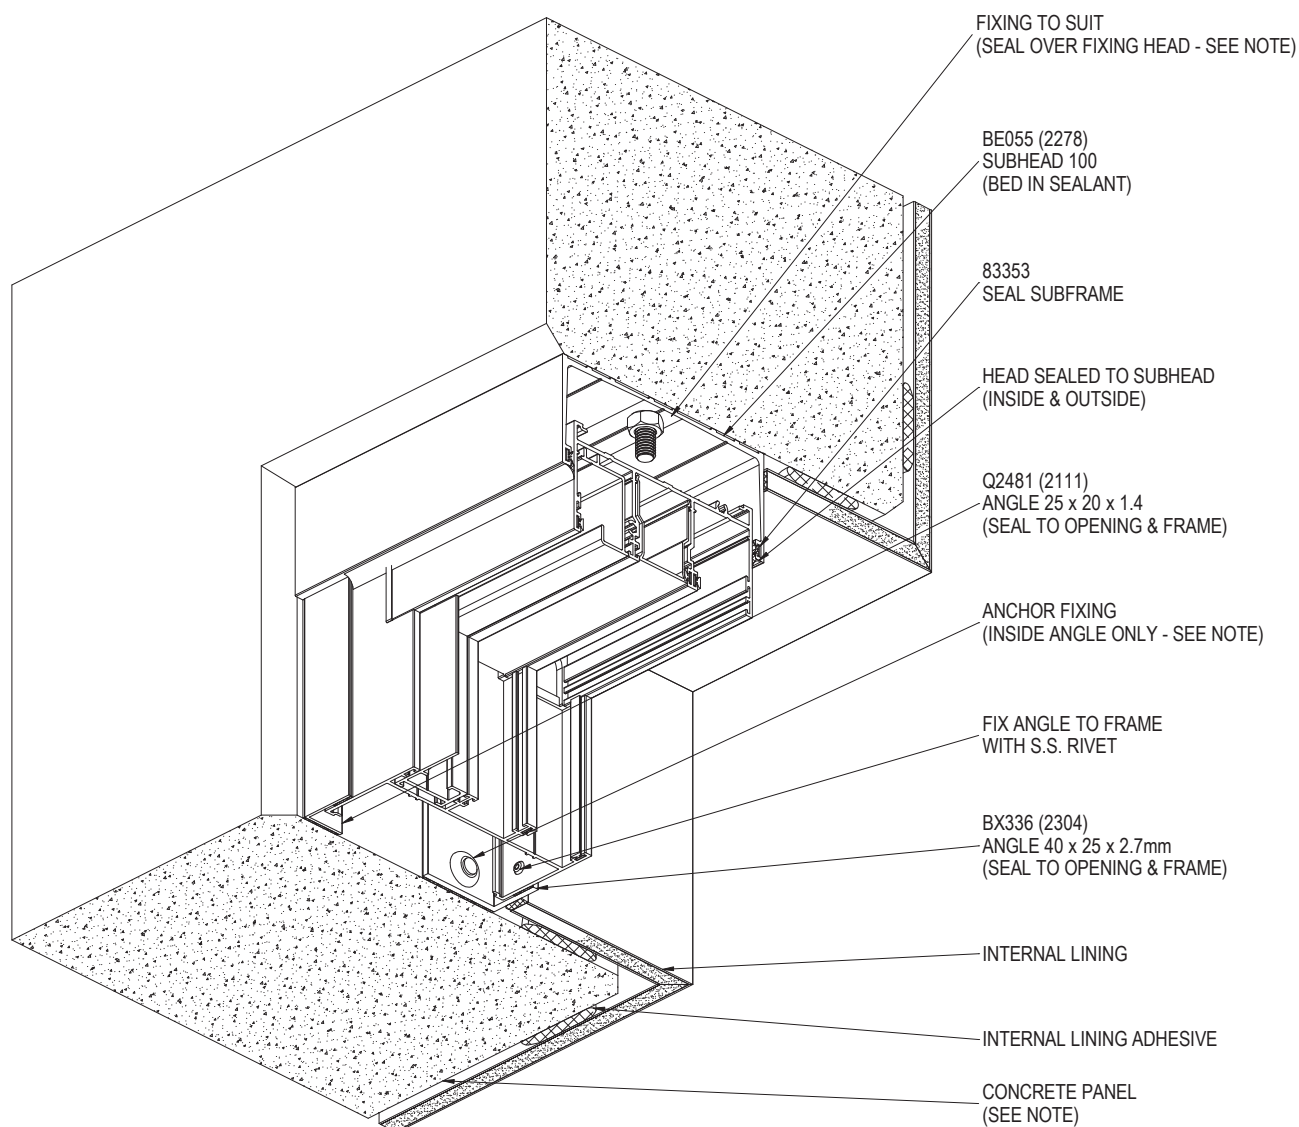

NOTE:

SURFACE OF CONCRETE TO WINDOW OPENING MUST BE TANKED WITH A SUITABLE SEALER TO PREVENT INGRESS OF MOISTURE. ENSURE SURFACES TO BE SEALED ARE SOUND, CLEAN, DRY AND FREE FROM ANY CONTAMINANTS BEFORE SEALING.

FIXING TYPES & CENTRES TO BE PROJECT SPECIFIC, REFER TO SPECIFICATION AND/OR ENGINEER.

PRODUCT NO: SIG 100 SW

DRAWING NO: SIG-SW100-02-10

DRAWN: DJH

DATE: 03/09/09


ISSUE: A

SCALE: 1 : 3




Bradnam's
windows & doors

SUBSILL DAM ANGLE INSTALLATION

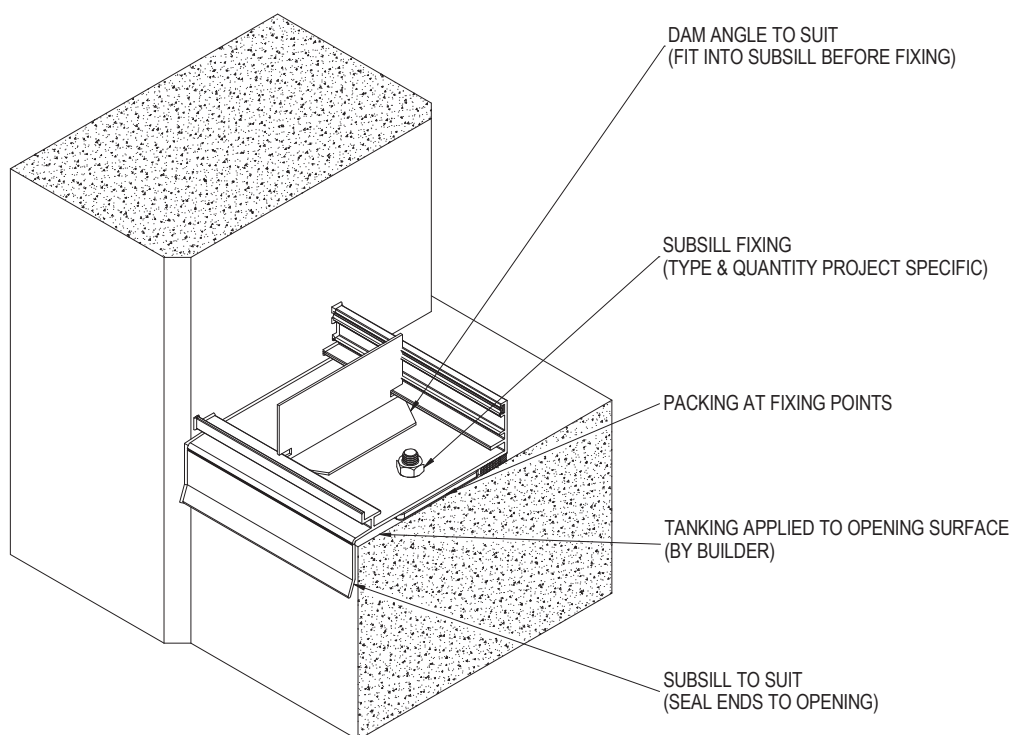

1. INSTALL SUBSILL INTO OPENING WITH DAM ANGLE FITTED. PACK SUBSILL LEVEL THEN FIX TO STRUCTURE. SEAL SUBSILL ENDS TO STRUCTURE.

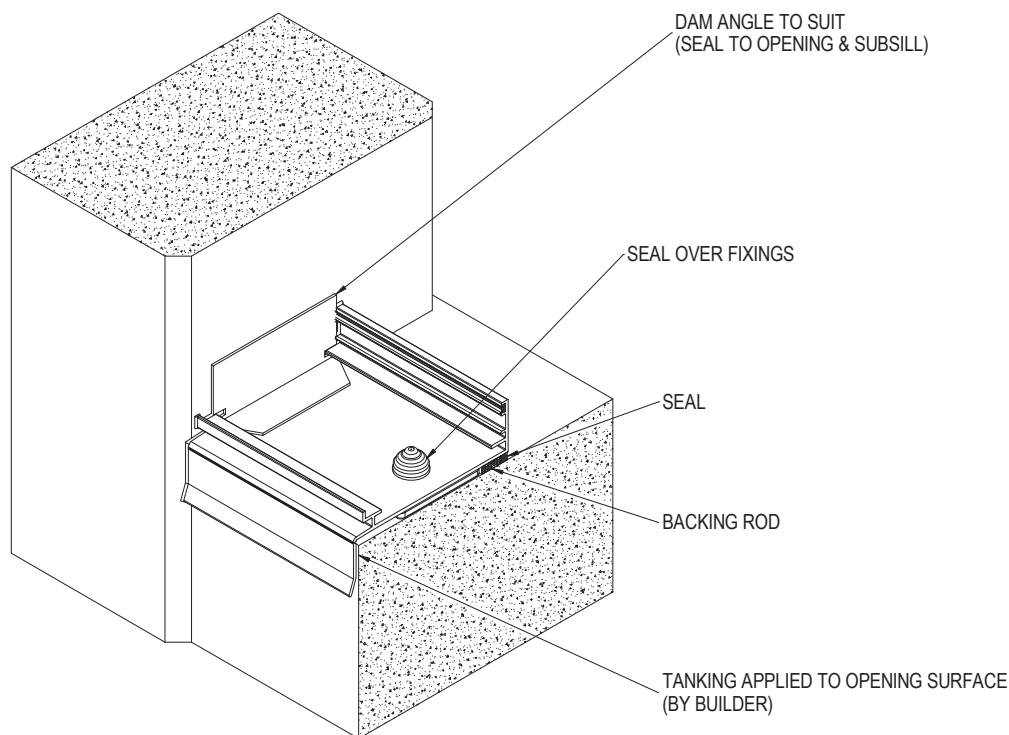

2. APPLY SEALANT TO VERTICAL FACE OF DAM ANGLE AND ALSO TO THE FLOOR OF THE SUBSILL. POSITION DAM ANGLE AGAINST STRUCTURE. SEAL ALL JOINTS BETWEEN ANGLE AND SUBSILL. SEAL ALL JOINTS BETWEEN ANGLE AND SUBSILL. SEAL OVER FIXINGS AND UNDER SUB SILL TO STRUCTURE.


PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-11
DRAWN: DJH

DATE: 03/09/09

ISSUE: A

SCALE: 1 : 4

TYPICAL SUBSILL DAM ANGLE INSTALLATION WITH FIXING & TRIM ANGLES

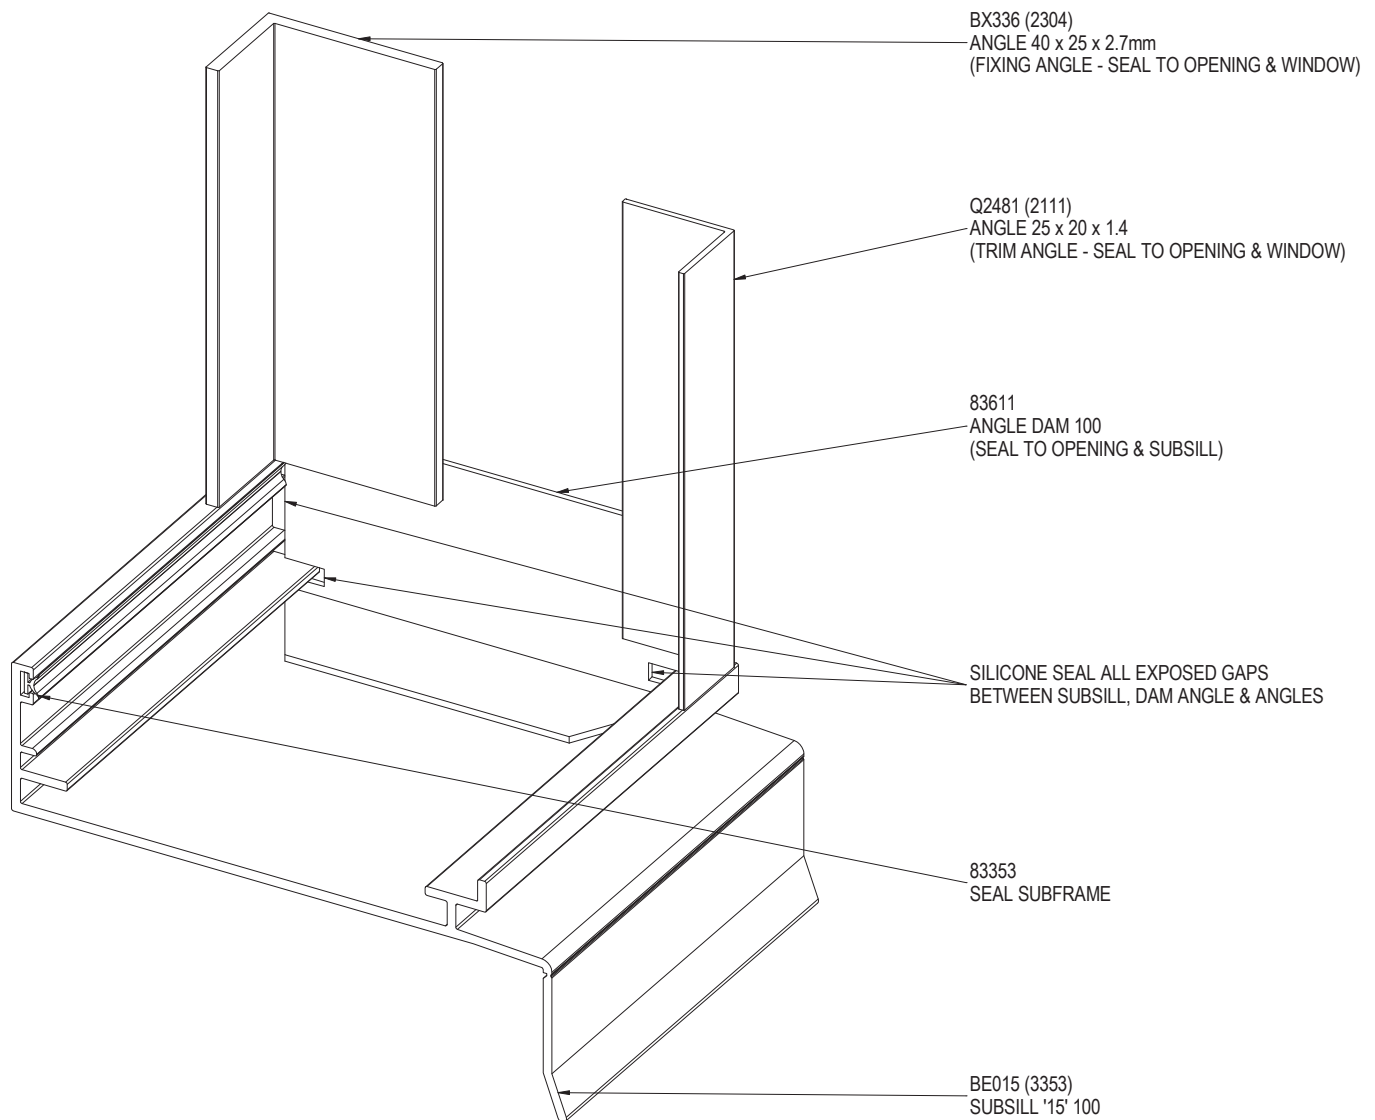

PRODUCT NO: SIG 100 SW
DRAWING NO: SIG-SW100-02-12
DRAWN: DJH

DATE: 03/09/09
ISSUE: A
SCALE: 1 : 1.5